


HPLC TEST RESULT

GHRP-2

Structure: GHRP-2
 Cas No : 18861-67-7
 Sequence: D-Ala-D-βNal-Ala-Trp-D-Phe-Lys-NH2
 Lot No: P191025-LR055255
 Number: 0200049
 Column: 250*4.6mm, Kromasil-C18-5um
 Solvent A: 0.1%TFA in 100%water
 Solvent B: 0.1%TFA in 100%acetonitrile
 Gradient:

	A	B
0.1min	85%	15%
25.0min	60%	40%
25.1min	0%	100%
30.0min	stop	

Flow Rate: 1.0ml/min
 Wavelength(nm): 220
 Volume: 10ul

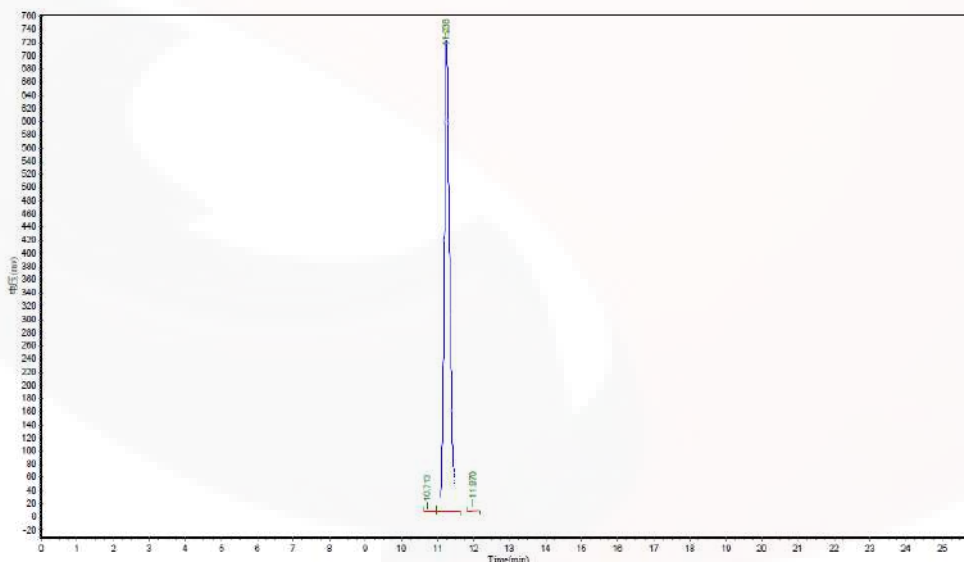

Peak No.	Ret Time	Height	Area	Conc.
1	10.713	2594.466	28184.912	0.3505
2	11.238	716453.188	7947660.500	98.8364
3	11.970	6408.082	65385.844	0.8131
				100.00